


332 Non Interval Technical Meter Details

332 Valid Codes	332 Valid Codes
Meter Point Status	Read Status (Removed and Retained Meters)
E or D only.	RV Reading which is plausible / valid
Read Reason (Removed meters)	RREL Reading was originally implausible but released on investigation as plausible
13 De-energisation	REST - Reading estimated- used for settlement
16 Closing Read before meter re-programming	Register Type
22 Closing Reading (Register removed)	01 24Hr
23 Meter Works single reading	02 Day
28 Closing read before register renumber	03 Night
Read Reason (New Meters)	04 NSH
11 Start read after meter re-programming	05 Wattless
18 Energisation	06 MD Normal
21 Start reading (New Register)	07 MD Peak
23 Meter Works single reading	08 Cumulative MD Normal
29 Start Read after register renumber	09 Cumulative MD Peak
Read Reason (Retained Meters)	Estimated Usage Factor
09 Special Read – Non Chargeable	Estimated Usage Factor is a statement in kWh of the estimated consumption for a given Timeslot at a Meter Point over the next year and is provided for the period following the read date. Where Meters have been installed EUF will be provided.
Read Type (Removed and Retained Meters)	Optional/Mandatory; Although the following Data Items are optional, note the following caveats:-
A Actual	Actual Usage Factor: Provided by the period terminating on the read date
E Estimated	Estimated Usage Factor: Provided for the period following the read date
EF Estimate (Implausible)	
Read Type (New Meters)	
A Actual only	

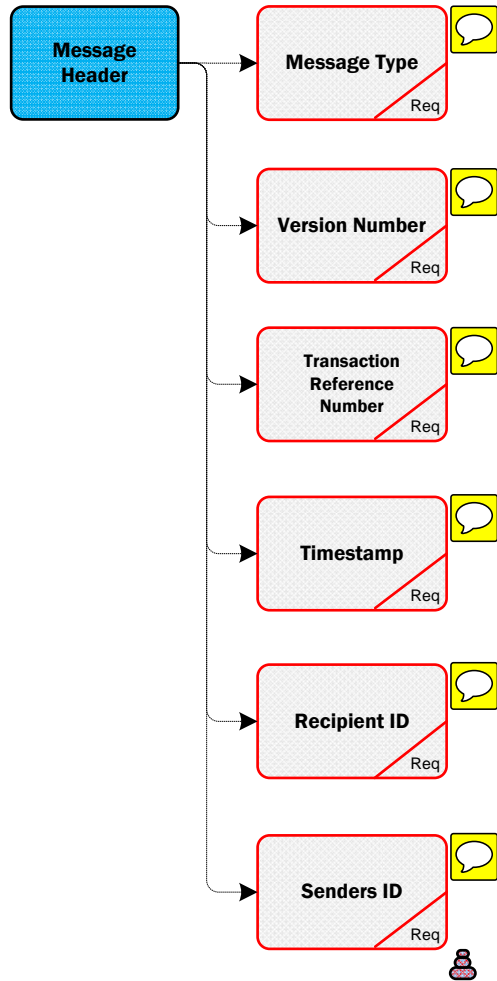

332 MPRN Level Info

MPRN
Req

Market Participant Business Reference
Opt

Networks Reference Number
Opt

Load Profile
Req


DUoS Group
Req


Meter Point Status
Req

Effective From Date
Req

Meter Configuration Code
Req

Tariff Configuration Code
Opt

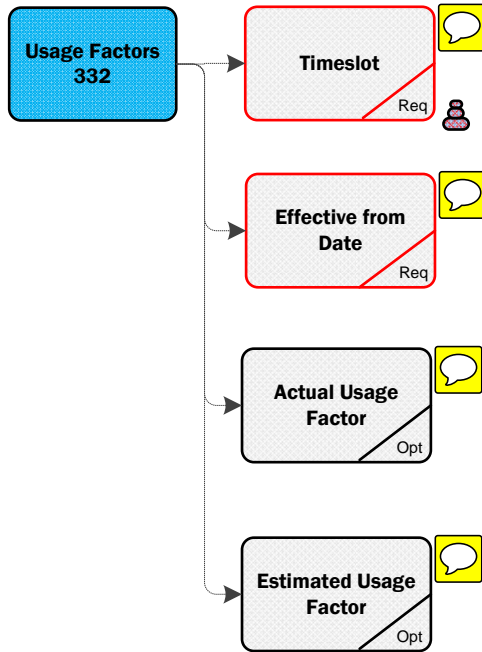

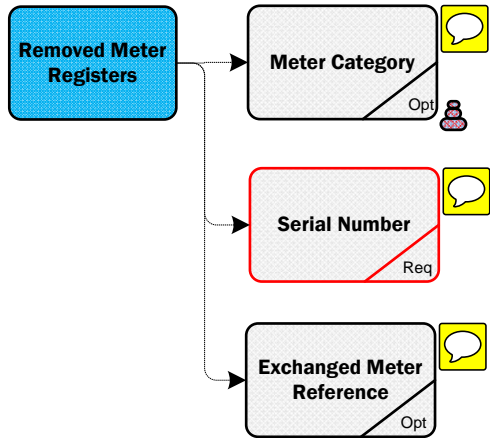


Removed Register Level Information

Meter Multiplier
Req 

Unit of Measurement
Req 


Timeslot
Req 




Meter Register Sequence
Req 


Previous Read Date
Req 

Read Type
Req 



Read Reason
Req 


Reading
Req 


Register Type
Req 


Pre Decimal Digits
Opt 

Post Decimal Digits
Opt 

Consumption
Opt 

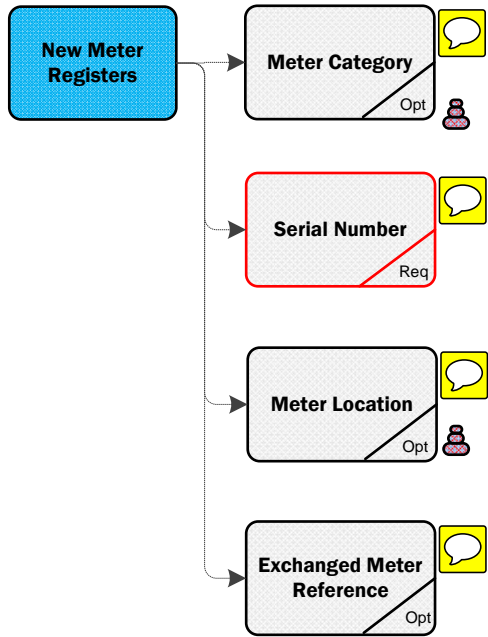

Read Status
Req 








New Register Level Information


Meter Register Sequence
Req 

Post Decimal Digits
Req 

Timeslot
Req 



Register Type
Req 


Unit of Measurement
Req 


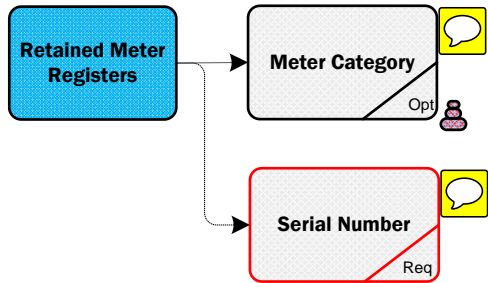
Pre Decimal Digits
Req 

Meter Multiplier
Req 

Reading
Req 

Read Reason
Req 


Read Type
Req 







Retained Register Level Information

Meter Register Sequence
Req



Unit of Measurement
Req



Timeslot
Req



Reading
Req





Meter Multiplier
Req



Previous Read Date
Req






Consumption
Opt






Read Reason
Req



Read Type
Req



Register Type
Req





Read Status
Req



Post Decimal Digits
Opt



Pre Decimal Digits
Opt



**Senders
ID**

**Click Here for Latest
Senders ID
List**

Load Profile

01 - Urban Domestic Unrestricted

10 - Unmetered - Flat

02 - Urban Domestic Day/Night

11 - Public Lighting Dusk/Dawn

03 - Rural Domestic Unrestricted

12 - Public Lighting Dusk/Midnight

04 - Rural Domestic Day/Night

05 - Non Domestic Unrestricted

06 - Non Domestic Day/Night

07 - MD with LF up to (but not including) 30%

08 - MD with LF greater than or equal to 30% but less than 50%

09 - MD with LF greater than or equal to 50%

Message

MPRN Level Information

332 Non Interval Technical Meter Details

Code


DUoS Group	AGU	DG1	Urban Domestic	DG7	MV MD
	AMM	DG10	Yes	DG7A	MV MD Autoproducer
	CAN	DG2	Rural Domestic	DG7B	MV MD Importing Autoproducer or CHP Producer
	CIP	DG3	Public Lighting	DG8	38 kV Looped MD
	COL	DG4	Unmetered Supplies	DG8A	38 kV Looped MD Autoproducer
	COS	DG5	LV Non-Domestic Non-MD	DG8B	38 kV Looped MD Importing Autoproducer or CHP Producer
	CUG	DG5A	LV Non-Domestic Non-MD Autoproducer	DG9	38 kV Tailed MD
	DIJ	DG5B	LV Non-Domestic Non-MD Importing Autoproducer or CHP Producer	DG9A	38 kV Tailed MD Autoproducer
	DSO	DG6	LV MD	DG9B	38 kV Tailed MD Importing Autoproducer or CHP Producer
	IA	DG6A	LV MD Autoproducer	DG10	110kV Distribution
	ICD	DG6B	LV MD Importing Autoproducer or CHP Producer	TCON	Transmission Connected

Message


MPRN Level Information

RMDS RETAIL MARKET DESIGN SERVICE

DUoS Group

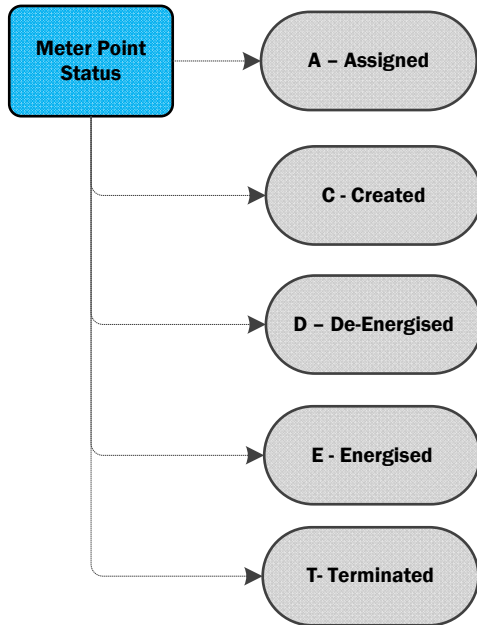



Meter Configuration Code				
MCC01 - 24 Hour	MCC10 - QH2CH_IP	MCC61 - 2x24h	MCC73 - 4x24H+NSH	
MCC02 - P/N	MCC11 - QH4CH_IPXP	MCC62 - 2x24h+NSH	MCC74 - 5x24H	
MCC03 - 24h+NSH	MCC50 - NONSTN	MCC63 - 2x24h+D	MCC75 - 24H+2xNSH	
MCC04 - D/N+W	MCC51 - D/N+NSH	MCC64 - 2x24h+W	MCC76 - 4x24H+W	
MCC05 - MDNm/PK	MCC53 - 2 X D/N	MCC65 - 3x24hr	MCC77 - 2x24H+W+NSH	
MCC06 - MDNm+Pk	MCC57 - 24h+D	MCC67 - 3x24h+Day	MCC78 - 3x24H+W+NSH	
MCC07 - 24H+NSH+W	MCC58 - 24h+D/N	MCC70 - 3x24H+NSH	MCC79 - 5x24H+NSH	
MCC08 - 24h+W	MCC59 - 24h+D/N+W	MCC71 - 4x24H		
MCC09 - Unmetered	MCC60 - 24h+D/N+NS	MCC72 - 3x24H+W		

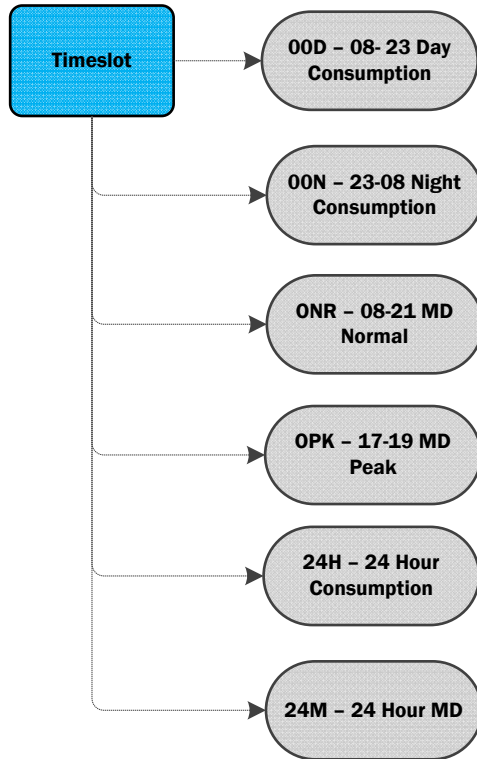

Meter Category

**Click Here for Latest
Meter Category
List**

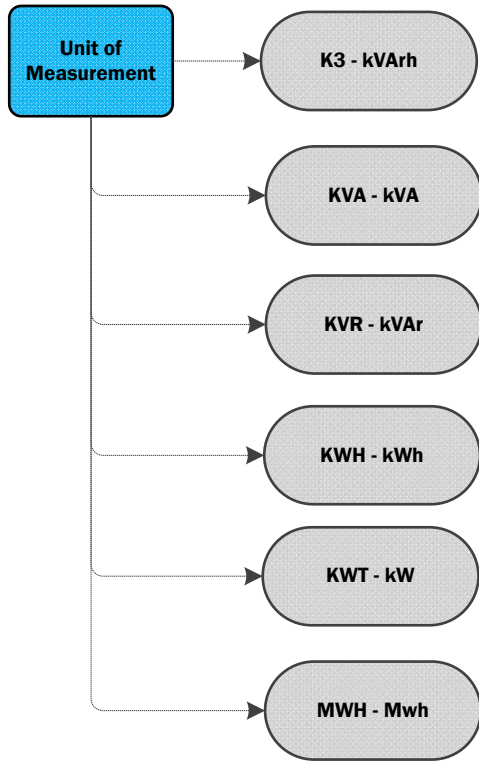

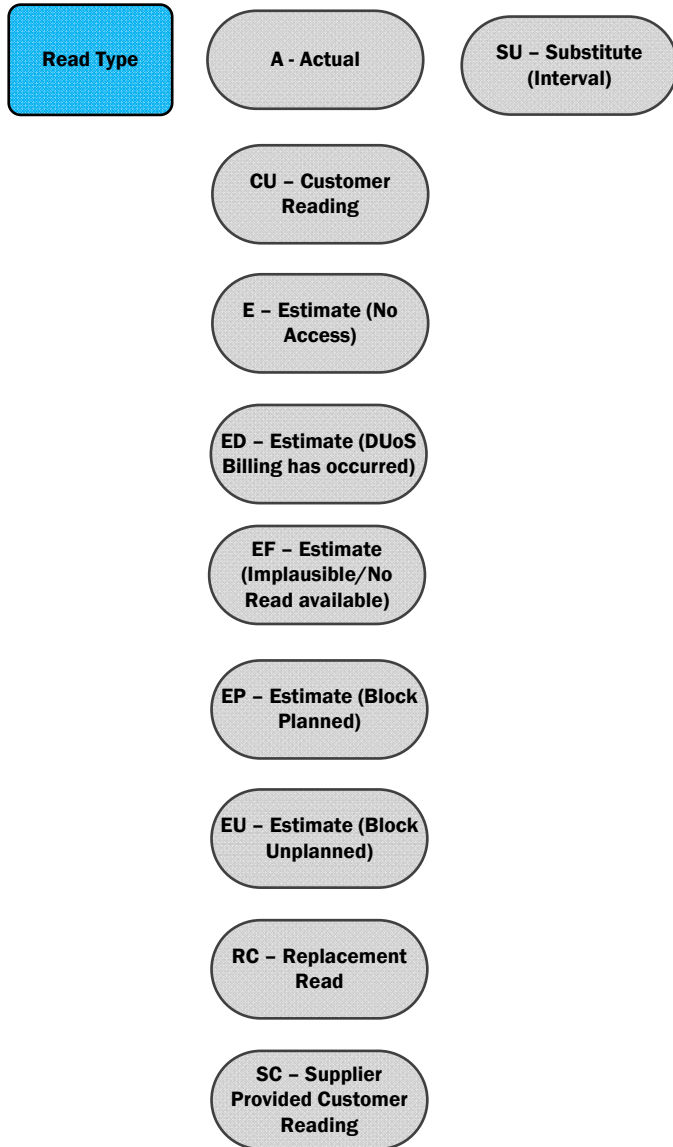

Read Reason

- | | | |
|-----------------------------------------------|---------------------------------------------|------------------|
| 01 - Scheduled | 17 - Change of Profile | 95 - Not for CoS |
| 02 - Special Read, Chargeable | 18 - Energisation | |
| 04 - Special Read to resolve dispute | 21 - Start Reading (New Register) | |
| 09 - Special Read, non chargeable | 22 - Closing Reading (Register removed) | |
| 10 - Ad-hoc, no chargeable check read | 23 - Meter Works Single reading | |
| 11 - Start reading after meter re-programming | 26 - Change of Supplier | |
| 13 - De-Energisation | 27 - Change of Legal Entity | |
| 14 - Estimate | 28 - Closing read before register re-number | |
| 16 - Closing read before meter re-programming | 29 - Star read after register re-number | |

Register Type

01 - 24hr

50 - IMP QH (KW)

02 - Day

51 - IMP QH (kVAr)

03 - Night

52 - EXP QH(KW)

04 - NSH

53 - EXP QH (kVAr)


05 - Wattless

06 - MD Normal

07 - MD Peak

08 - Cumulative MD Normal

09 - Cumulative MD Peak

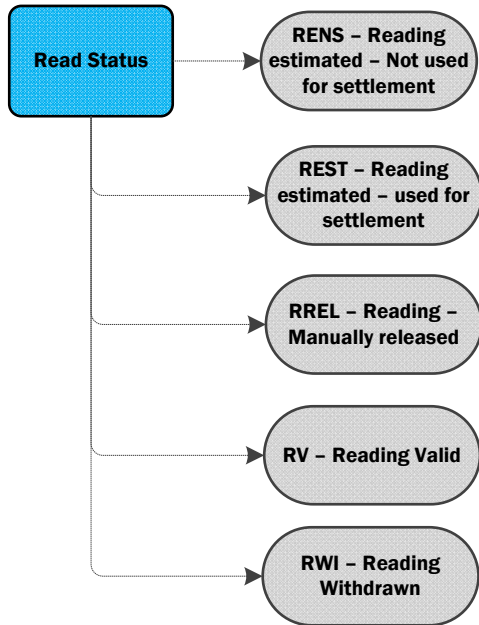

Meter Location

01 - Basement	10 - Pumphouse	19 - Annexe
02 - Garage	11 - Scullery/ Pantry/Kitchen	20 - Milking parlour/ Dairy
03 - Hall	12 - Shop	21 - Workshop
04 - Kitchen	13 - Switchroom/ Board	22 - Store
05 - Landing	14 - Under Stairs	23 - Back door
06 - Office	15 - Car Park	24 - Bedroom
07 - Outside box	16 - Pole	25 - Boiler House
08 - Porch	17 - Lobby	26 - Factory
09 - Press	18 - Shed/Outoffice/ Barn	

Version Which Implemented	Source of Change	Description of Change
10.4	MCR 1155	Message format changed from ARIS to Document format.
10.6	CoBLCR 008 & CoBLCR 011	Meter Category - Removed table & replaced with link to Meter Category page on RMDS Website